



Date 02/10/2018

Certificate Serial No/Ref:

50245815



DSR EMS LTD

ELECTRICAL INSTALLATION CONDITION REPORT

(Requirements for Electrical Installations – BS 7671 IET Wiring Regulations)

A. DETAILS OF THE CLIENT OR PERSON ORDERING THE WORK

Name: Dodd Group (Midlands) Ltd

Address: Unit 1 Rabone Park Rabone Lane Birmingham B66 2NN

B. REASON FOR PRODUCING THIS REPORT

To asses and report on the condition of the electrical installation of the mains services to the landlords lighting and power

Date(s) inspection and testing carried out:

02-10-2018

C. DETAILS OF THE INSTALLATION WHICH IS THE SUBJECT OF THIS REPORT

Occupier: SCH

Address: Downing House Willow Way Birmingham B37 7PN

Description of premises: ☐ N/A Domestic ☒ Commercial ☐ N/A Industrial ☐ N/A Other, please specify :

Estimated age of the wiring system Years Evidence of additions or alterations ☒ Yes ☐ N/A No ☐ N/A Not apparent

Installation records available? Yes ☐ N/A No ☒ Date of last inspection If yes, estimated age years Alternative source of supply (as described in attached schedule if applicable)

D. EXTENT AND LIMITATIONS OF INSPECTION AND TESTING

The inspection and testing detailed in this report and accompanying schedules have been carried out in accordance with BS 7671:2008 as amended

Extent of the electrical installation covered by this report

Agreed limitations including the reasons, see Regulations 634.2

Unable to get access to outside floodlights and booster pump in boiler house to test circuits , dry riser sockets rcd faulty and unable to test because of this, consequently the circuit was disconnect until a new rcd unit can be fitted and then tested

Limitations agreed with

Position (if applicable)

Operational limitations including the reasons

It should be noted that cables concealed within trunking and conduits, under floors, in roof spaces, and generally within the fabric of the building or underground, have not been inspected unless specifically agreed between the client and inspector prior to the inspection. An inspection should be made within accessible roof space housing other electrical equipment.

E. SUMMARY OF THE CONDITION OF THE INSTALLATION

General condition of the installation (in terms of electrical safety)

Generally in a good condition for age of wiring apart from lights on roof showing signs of excessive wearing

Overall assessment of the installation in terms of its suitability for continued use:

UNSATISFACTORY

An unsatisfactory assessment indicates that dangerous (code C1) and/or potentially dangerous (code C2) conditions have been identified

F. RECOMMENDATIONS

Where the overall assessment of the suitability of the installation for continued use on page 1 is stated as UNSATISFACTORY, I/we recommend that any observations classified as 'Danger present' (Code C1) or 'Potentially dangerous' (Code C2) are acted upon as a matter of urgency. Investigation without delay is recommended for observations identified as 'Further investigation required' (FI) Observations classified as 'improvement recommended' (Code C3) should be given due consideration.

Subject to the necessary remedial action being taken, I/we recommend that the installation is further inspected and tested by

02/10/2019

G. DECLARATION

I/We, being the person(s) responsible for the inspection and testing of the electrical installation (as indicated by my/our signature(s) below), particulars of which are described above, having exercised reasonable skill and care when carrying out the inspection and testing, hereby declare that the information in this report, including the observations and the attached schedules, provides an accurate assessment of the condition of the electrical installation taking into account the stated extent and limitations in section D of this report.

INSPECTED AND TESTED BY:

Name (CAPITALS)

Daniel Beechey

Signature



Position

QS

Date

02/10/2018

Contact

Tel

Email

Web

REPORT AUTHORISED FOR ISSUE BY:

Contractor

DSR EMS LTD

Address

Unit 4
118 Linden Road
Brownhills WS87BW

Name

Daniel Beechey

Signature



ENROLMENT NO (If applicable)

606552000

Date

02/10/2018

H. SCHEDULES

The attached schedule(s) are part of this document and this report is valid only when they are attached to it

N/A

Schedule(s) of inspection and

N/A

Schedule(s) of test results attached

I. SUPPLY CHARACTERISTICS AND EARTHING ARRANGEMENTS

Earthing Arrangements(s)	Number and Type of Live Conductors	Nature of Supply Parameters	Characteristics of Primary Over current Protective Device(s)
N/A TN-S	✓ AC N/A DC	Nominal voltage 400 Volts Nominal frequency 50 Hz PFC 1.60 kA External loop impedance 0.14 Ω Note: (1) by enquiry (2) by enquiry or by measurement	BS (EN) BS 1361 Type Fuse HBC - Type 2 Rated current 100 Short circuit capacity 33
✓ TN-C-S	N/A 1 phase (2 wire) N/A 2 wire		
N/A TT	N/A 2 phase (3 wire) N/A 1 phase (3 wire) N/A 3 wire		
N/A IT	N/A 3 phase (3 wire) ✓ 3 phase (4 wire) N/A Other		
N/A TN-C			Confirmation of Supply Polarity ✓

J. PARTICULARS OF INSTALLATION REFERRED TO IN THIS REPORT

Means of earthing	✓	Distributor's facility	Type	N/A	Resistance to earth	N/A	Ω
	N/A	Installation earth electrode	Location of the earth electrode (Where applicable)	N/A			

MAIN PROTECTIVE CONDUCTORS (to extraneous conductive parts)

Earthing Conductor

Conductor Material

Copper

Conductor Csa mm²

Strap

Connection/continuity verified

✓

Main protective bonding conductor

Conductor Material

Copper

Conductor Csa mm²

16

Connection/continuity verified

✓

Main Bonding

✓

Water installation pipes

✓

Structural steel

N/A

Gas installation pipes

✓

Other (specify)

N/A

Oil installation pipes

MAIN SWITCH/SWITCH-FUSE/CIRCUIT BREAKER/RCD

Type BS (EN)

60947-3

Voltage rating

400

V

No of poles

3

Current Rating

100

A

Supply Conductor

Copper

*Rated time delay

N/A

ms

Conductor csa mm²

25

*Rated RCD Operating current

N/A

mA

*RCD Operating time

N/A

ms

* If RCD main switch

DSR EMS LTD

Completed using icertifi electrical certificates for iOS

Page 2 of 17

50245815

K. OBSERVATIONS

Referring to the attached schedules of inspection and test results, and subject to the limitations specified at the Extent and Limitations of the inspection and testing section

☐ N/A No remedial action is required
 ☒ ✓ The following observations are made

[illegible]

N/A	Additional observations	Additional notes/observations attached or to follow ref:	N/A
-----	-------------------------	--	-----

One of the following codes, as appropriate, has been allocated to each of the observations made above to indicate to the person(s) responsible for the installation the degree of urgency for remedial action.

C1 – Danger present. Risk of injury. Immediate remedial action required

C2 – Potentially dangerous – urgent remedial action required

C3 – Improvement recommended

FI – Further investigation required without delay

Distribution Board Details for Downing House Willow Way B37 7PN																		
DB ref:	CB1		Zs at this board (Ω):	0.15	lpf at this board (kA):	1.50	Main switch type BSEN	60947-3		Rating:	100	Amps	Supply	25	mm²	Earth:	16	mm²
Distribution board location:	Landlords mains room		Phase Sequence Confirmed (where appropriate)		✓		Supplied from:	Mains		No. Of phases:	Three	Supply protective device type BSEN reference:		BS88 Fuse HRC - Type gG		Rating:	80	Amps
Circuit Details									Test Results									

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
Live (mm²)		cpc (mm²)	Type BS EN		Rating (A)	Short circuit capacity (kA)		IΔn mA	Ring final circuits only (Measured end to end)				All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω	Test button functionality	At IΔn ms	At 5 x IΔn ms					
									r ₁ (line)	r _n (neutral)	r ₂ (cpc)		(R1 + R2)	R ₂												

1/L1	Landing lights even half	B	B		2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	1.37	N/A	N/A	>500	>500	>500	✓	1.55	N/A	N/A	N/A
1/L2	Landing lights even full	B	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.58	N/A	N/A	>500	>500	>500	✓	0.74	N/A	N/A	N/A
1/L3	Bin lights	B	B	2	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.18	N/A	N/A	>500	>500	>500	✓	0.35	N/A	N/A	N/A
2/L1	Caretaker store lights	B	B	2	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.12	N/A	N/A	>500	>500	>500	✓	0.27	N/A	N/A	N/A
2/L2	Caretakers room lights	B	B	7	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.24	N/A	N/A	>500	>500	>500	✓	0.40	N/A	N/A	N/A
2/L3	Caretakers store socket radial	B	B	1	2.5	1.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.02	N/A	N/A	>500	>500	>500	✓	0.17	N/A	N/A	N/A
3/L1	Landing lights odd half	B	B	10	2.5	1.5	0.4	60898 type B	10	10	N/A	4.4	N/A	N/A	N/A	1.72	N/A	N/A	>500	>500	>500	✓	1.94	N/A	N/A	N/A
3/L2	Landing lights odd full	B	B		2.5	1.5	0.4	60898 type B	10	10	N/A	4.4	N/A	N/A	N/A	1.11	N/A	N/A	>500	>500	>500	✓	1.28	N/A	N/A	N/A
3/L3	Ground floor lights	B	B	5	2.5	1.5	0.4	60898 type B	10	10	N/A	4.4	N/A	N/A	N/A	0.56	N/A	N/A	>500	>500	>500	✓	0.71	N/A	N/A	N/A
4/L1	Ground floor lights	B	B	14	2.5	1.5	0.4	60898 type B	10	10	N/A	4.4	N/A	N/A	N/A	1.01	N/A	N/A	>500	>500	>500	✓	1.17	N/A	N/A	N/A
4/L2	CCTV spurs ring	B	B	3	4	2.5	0.4	60898 type B	32	10	N/A	1.4	0.17	0.17	0.27	0.11	N/A	N/A	>500	>500	>500	✓	0.21	N/A	N/A	N/A
4/L3	CCTV spurs radial	B	B	2	4	2.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.12	N/A	N/A	>500	>500	>500	✓	0.28	N/A	N/A	N/A
5/L1	Caretaker store sockets	B	B	3	4	2.5	0.4	60898 type B	32	10	N/A	1.4	0.14	0.14	0.22	0.09	N/A	N/A	>500	>500	>500	✓	0.19	N/A	N/A	N/A
5/L2	W/H caretakers and W/c	B	B	3	4	2.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.07	N/A	N/A	>500	>500	>500	✓	0.22	N/A	N/A	N/A
5/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6/L1	Mains room light	B	B	2	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.03	N/A	N/A	>500	>500	>500	✓	0.19	N/A	N/A	N/A



Distribution board reference: CB1

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂									
6/L2	Easi Check panel em lights	B	B	3	2.5	1.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.02	N/A	N/A	>500	>500	>500	✓	0.17	N/A	N/A	N/A
6/L3	Fire alarm supply	H	C	1	2.5	Micc	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.10	N/A	N/A	>500	>500	>500	✓	0.26	N/A	N/A	N/A
7/L1	Dry riser sockets	A	C	10	2.5	Micc	0.4	61008 RCD	30	10	30	1.4	N/A	N/A	N/A	Lim	N/A	N/A	>500	>500	>500	✓	Lim	✓	N/A	N/A
7/L2	Riser sockets landlords mains side	H	C	10	2.5	Micc	0.4	61008 RCD	25	10	30	1.4	N/A	N/A	N/A	0.59	N/A	N/A	>500	>500	>500	✓	0.75	✓	22.9	8.97
7/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8/L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8/L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
8/L3	Econ fuse spurs ground floor dry riser	A	C	5	2.5	2.5	0.4	60898 type B	32	10	N/A	1.4	0.57	0.56	0.57	0.28	N/A	N/A	>500	>500	>500	✓	0.37	N/A	N/A	N/A

Distribution Board Details for Downing House Willow Way B37 7PN																		
DB ref:	CB2		Zs at this board (Ω):	0.13	lpf at this board (kA):	1.72	Main switch type BSEN	60947-3		Rating:	100	Amps	Supply	25	mm²	Earth:	16	mm²
Distribution board location:	Landlords mains room		Phase Sequence Confirmed (where appropriate)		✓		Supplied from:	Mains		No. Of phases:	Three	Supply protective device type BSEN reference:		BS88 Fuse HRC - Type gG		Rating:	80	Amps
Circuit Details									Test Results									

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂									
1/L1	Landing lights floor 1	D	B	3	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.52	N/A	N/A	>500	>500	>500	✓	0.67	N/A	N/A	N/A
1/L2	Landing lights floor 2	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.61	N/A	N/A	>500	>500	>500	✓	0.75	N/A	N/A	N/A
1/L3	Landing lights floor 3	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.66	N/A	N/A	>500	>500	>500	✓	0.80	N/A	N/A	N/A
2/L1	Landing lights floor 1	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.56	N/A	N/A	>500	>500	>500	✓	0.69	N/A	N/A	N/A
2/L2	Landing lights floor 2	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.68	N/A	N/A	>500	>500	>500	✓	0.82	N/A	N/A	N/A
2/L3	Landing lights floor 3	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.61	N/A	N/A	>500	>500	>500	✓	0.76	N/A	N/A	N/A
3/L1	Landing lights floor 4	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.68	N/A	N/A	>500	>500	>500	✓	0.81	N/A	N/A	N/A
3/L2	Landing lights floor 5	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.76	N/A	N/A	>500	>500	>500	✓	0.89	N/A	N/A	N/A
3/L3	Landing lights floor 6	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.63	N/A	N/A	>500	>500	>500	✓	0.76	N/A	N/A	N/A
4/L1	Landing lights floor 4	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.65	N/A	N/A	>500	>500	>500	✓	0.80	N/A	N/A	N/A
4/L2	Landing lights floor 5	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.80	N/A	N/A	>500	>500	>500	✓	0.94	N/A	N/A	N/A
4/L3	Landing lights floor 6	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.52	N/A	N/A	>500	>500	>500	✓	0.65	N/A	N/A	N/A
5/L1	Landing lights floor 7	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.77	N/A	N/A	>500	>500	>500	✓	0.92	N/A	N/A	N/A
5/L2	Landing lights floor 8	D	B	4	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.71	N/A	N/A	>500	>500	>500	✓	0.85	N/A	N/A	N/A
5/L3	Landing lights floor 7	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.74	N/A	N/A	>500	>500	>500	✓	0.87	N/A	N/A	N/A
6/L1	Landing lights floor 8	D	B	8	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.80	N/A	N/A	>500	>500	>500	✓	0.93	N/A	N/A	N/A



Distribution board reference: CB2

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD			
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms	
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂										
6/L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
6/L3	Caretaker side riser lights	D	B	9	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.35	N/A	N/A	N/A	>500	>500	>500	✓	0.48	N/A	N/A	N/A
7/L1	Solar pv	G	C	1	4	4	0.4	60898 type D	20	10	N/A	36.1	N/A	N/A	N/A	0.13	N/A	N/A	N/A	>500	>500	>500	✓	0.26	N/A	N/A	N/A
7/L2	Solar pv	G	C	1	4	4	0.4	60898 type D	20	10	N/A	18.5	N/A	N/A	N/A	0.12	N/A	N/A	N/A	>500	>500	>500	✓	0.25	N/A	N/A	N/A
7/L3	Caretaker side riser sockets	B	B	9	4	2.5	0.4	60898 type C	32	10	N/A	0.7	0.38	0.38	0.60	0.24	N/A	N/A	N/A	>500	>500	>500	✓	0.32	N/A	N/A	N/A
8/L1	Caretaker side riser lights	D	B	9	2.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.31	N/A	N/A	N/A	>500	>500	>500	✓	0.45	N/A	N/A	N/A
8/L2	CCTV spurs dry riser	B	B	9	4	2.5	0.4	60898 type C	32	10	N/A	0.7	0.38	0.38	0.60	0.24	N/A	N/A	N/A	>500	>500	>500	✓	0.36	N/A	N/A	N/A
8/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	

DISTRIBUTION BOARD DETAILS FOR																		Downing House Willow Way B37 7PN									
DB ref:	CB3		Zs at this board (Ω):	0.18	lpf at this board (kA):	1.3	Main switch type BSEN	60947-3		Rating:	100	Amps	Supply	16	mm ²	Earth:	16	mm ²									
Distribution board location:	Roof lift motor room		Phase Sequence Confirmed (where appropriate)		N/A		Supplied from:	Mains		No. Of phases:	Single	Supply protective device type BSEN reference:		BS88 Fuse HRC - Type gG		Rating:	63	Amps									
CIRCUIT DETAILS										TEST RESULTS																	

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂									
1	Lift motor room sockets	D	B	2	2.5	1.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.04	N/A	N/A	>500	>500	>500	✓	0.22	N/A	N/A	N/A
2	Lift motor room heater	B	B	2	2.5	1.5	0.4	60898 type B	16	10	N/A	2.8	N/A	N/A	N/A	0.13	N/A	N/A	>500	>500	>500	✓	0.31	N/A	N/A	N/A
3	Lift motor room lights	B	B	7	1.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.26	N/A	N/A	>500	>500	>500	✓	0.45	N/A	N/A	N/A
4	Fan	B	B	2	1.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.09	N/A	N/A	>500	>500	>500	✓	0.29	N/A	N/A	N/A
5	Exterior lights	B	B	9	1.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.23	N/A	N/A	>500	>500	>500	✓	0.41	N/A	N/A	N/A
6	Tv room light	B	B	1	1.5	1.5	0.4	60898 type C	6	10	N/A	3.6	N/A	N/A	N/A	0.22	N/A	N/A	>500	>500	>500	✓	0.40	N/A	N/A	N/A
7	Fan control panel	B	B	1	6	6	0.4	60898 type B	16	10	N/A	2.8	N/A	N/A	N/A	0.02	N/A	N/A	>500	>500	>500	✓	0.20	N/A	N/A	N/A



DISTRIBUTION BOARD DETAILS FOR Downing House Willow Way B37 7PN																		
DB ref:	CBL		Zs at this board (Ω):	0.14	lpf at this board (kA):	1.69	Main switch type BSEN	60947-3		Rating:	100	Amps	Supply	16	mm ²	Earth:	SWA	mm ²
Distribution board location:	Landlords mains room		Phase Sequence Confirmed (where appropriate)		✓	Supplied from:	Mains			No. Of phases:	Three	Supply protective device type BSEN reference:		BS88 Fuse HRC - Type gG		Rating:	32	Amps
CIRCUIT DETAILS									TEST RESULTS									

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂									
1/L1	Flood light	G	C	4	2.5	2.5	0.4	60898 type C	10	10	N/A	2.2	N/A	N/A	N/A	LIM	N/A	N/A	>500	>500	>500	✓	LIM	N/A	N/A	N/A
1/L2	Flood light	G	C	4	2.5	2.5	0.4	60898 type C	10	10	N/A	2.2	N/A	N/A	N/A	LIM	N/A	N/A	>500	>500	>500	✓	LIM	N/A	N/A	N/A
1/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
2/L1	Pcu rack and door entry	A	C	3	2.5	2.5	0.4	60898 type C	16	10	N/A	1.4	N/A	N/A	N/A	0.15	N/A	N/A	>500	>500	>500	✓	0.29	N/A	N/A	N/A
2/L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
2/L3	Time clock and photo cell	A	C	2	1.5	1.5	0.4	60898 type C	10	10	N/A	2.2	N/A	N/A	N/A	0.42	N/A	N/A	>500	>500	>500	✓	0.58	N/A	N/A	N/A
3/L1	Canopy lights	H	C	7	1.5	Micc	0.4	60898 type C	10	10	N/A	2.2	N/A	N/A	N/A	0.60	N/A	N/A	>500	>500	>500	✓	0.76	N/A	N/A	N/A
3/L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
3/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4/L1	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4/L2	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
4/L3	Spare	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A



DISTRIBUTION BOARD DETAILS FOR Downing House Willow Way B37 7PN

DB ref:	Odd lift	Zs at this board (Ω):	0.17	lpf at this board (kA):	1.37	Main switch type BSEN	60947-3 Isolator	Rating:	100	Amps	Supply	16	mm ²	Earth:	SWA	mm ²
Distribution board location:	Roof lift motor room	Phase Sequence Confirmed (where appropriate)	✓	Supplied from:	Mains			No. Of phases:	Three	Supply protective device type BSEN reference:	BS88 Fuse HRC - Type gG			Rating:	80	Amps

CIRCUIT DETAILS

TEST RESULTS

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors	Max disconnection time permitted	Over current devices	RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
Live (mm²)	cpc (mm²)	Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA	Ring final circuits only (Measured end to end)	All circuits (At least one column to be completed)	Live/Live M Ω		Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω	Test button functionality	At IΔn ms	At 5 x IΔn ms								

[illegible]

DSR EMS LTD Unit 4 118 Linden Road WS87BW

Report pages including inspection and test schedules **10 of 17**

DISTRIBUTION BOARD DETAILS FOR Downing House Willow Way B37 7PN

DB ref:	Even lift	Zs at this board (Ω):	0.19	lpf at this board (kA):	1.20	Main switch type BSEN	60947-3 Isolator	Rating:	100	Amps	Supply	16	mm ²	Earth:	SWA	mm ²
Distribution board location:	Roof lift motor room	Phase Sequence Confirmed (where appropriate)	✓	Supplied from:	Mains			No. Of phases:	Three	Supply protective device type BSEN reference:	BS88 Fuse HRC - Type gG			Rating:	80	Amps

CIRCUIT DETAILS

TEST RESULTS

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors		Max disconnection time permitted	Over current devices			RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
					Live (mm²)	cpc (mm²)		Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA		Ring final circuits only (Measured end to end)			All circuits (At least one column to be completed)		Live/Live M Ω	Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω			Test button functionality	At IΔn ms	At 5 x IΔn ms
													r ₁ (line)	r _n (neutral)	r ₂ (cpc)	(R1 + R2)	R ₂									

[illegible]

DSR EMS LTD Unit 4 118 Linden Road WS87BW

Completed using iCertifi electrical certificates ©
Report pages including inspection and test schedules 11 of 17

DISTRIBUTION BOARD DETAILS FOR Downing House Willow Way B37 7PN

DB ref:	Booster pumps	Zs at this board (Ω):	LIM	lpf at this board (kA):	LIM	Main switch type BSEN	60947-3 Isolator	Rating:	63	Amps	Supply	25	mm ²	Earth:	25	mm ²
Distribution board location:	Landlords mains room	Phase Sequence Confirmed (where appropriate)	N/A	Supplied from:	Mains	No. Of phases:	Single	Supply protective device type BSEN reference:	BS88 Fuse HRC - Type gG	Rating:	40	Amps				

CIRCUIT DETAILS

TEST RESULTS

Circuit Reference	Circuit Designation	Type of wiring	Reference method	Number of points served	Circuit conductors	Max disconnection time permitted	Over current devices	RCD	Max Zs(Ω) Permitted by BS7671	Continuity Ω					Insulation resistance				Polarity Insert ✓ or X	Measured Zs Ω	RCD		
Live (mm²)	cpc (mm²)	Type BS EN	Rating (A)	Short circuit capacity (kA)	IΔn mA	Ring final circuits only (Measured end to end)	All circuits (At least one column to be completed)	Live/Live M Ω		Line/Neutral M Ω	Live/Earth M Ω	Neutral/Earth M Ω	Test button functionality	At IΔn ms	At 5 x IΔn ms								

[illegible]

DSR EMS LTD Unit 4 118 Linden Road WS87BW

Report pages including inspection and test schedules **12 of 17**

TEST INSTRUMENTS USED

Earth fault loop impedance

N/A

RCD

N/A

Insulation resistance

N/A

MFT

1003319101756850

Continuity

N/A

Other

N/A

Inspected by:

Signature



Name
(CAPITALS)

Daniel Beechey

Date of
inspection

02/10/2018

EICR IMAGES

Engineers optional images of C1 or C2 observations if applicable



N. INSPECTION SCHEDULE FOR A DISTRIBUTION BOARD INSTALLATION									
Outcomes		Acceptable Condition ✓	Unacceptable condition C1 or C2	Improvement recommended C3	Further investigation: FI	Not Verified: NV	Limitation: LIM	Not Applicable: N/A	
ITEM	DESCRIPTION						OUTCOME (Use codes above. Provide additional comment where appropriate. C1, C2, C3 and FI coded items to be recorded in Section K of the Condition Report)		
1.0	DISTRIBUTOR'S / SUPPLY INTAKE EQUIPMENT								
1.1	Condition of service cable						✓		
1.2	Condition of service head						✓		
1.3	Condition of distributor's earthing arrangement						✓		
1.4	Condition of meter tails - Distributor/Consumer						✓		
1.5	Condition of metering equipment						✓		
1.6	Condition of isolator (where present)						✓		
2.0	PRESENCE OF ADEQUATE ARRANGEMENTS FOR OTHER SOURCES SUCH AS MICROGENERATORS (551.6; 551.7)						N/A		
3.0	EARTHING AND BONDING ARRANGEMENTS (411.3, Chapter 54)								
3.1	Presence and condition of distributor's earthing arrangement (542.1.2.1; 542.1.2.2)						✓		
3.2	Presence and condition of earth electrode connection where applicable (542.1.2.3)						N/A		
3.3	Provision of earthing/bonding labels at all appropriate locations (514.13)						✓		
3.4	Adequacy of earthing conductor size (542.3, 543.1.1)						✓		
3.5	Accessibility and condition of earthing conductor at MET (543.3.2)						✓		
3.6	Adequacy of main protective bonding conductor sizes (544.1)						✓		
3.7	Condition and accessibility of main protective bonding conductor connections (543.3.2; 544.1.2)						✓		
3.8	Accessibility and condition of other protective bonding connections (543.3.2)						✓		
4.0	CONSUMER UNIT OR DISTRIBUTION BOARD								
4.1	Adequacy of working space / accessibility to consumer unit / distribution board (132.12; 513.1)						✓		
4.2	Security of fixing (134.1.1)						✓		
4.3	Condition of enclosure(s) in terms of IP rating etc (416.2)						✓		
4.4	Condition of enclosure(s) in terms of fire rating etc (421.1.201; 526.5)						✓		
4.5	Enclosure not damaged or deteriorated so as to impair safety (621.2 iii)						✓		
4.6	Presence of main linked switch (as required by 537.1.4)						✓		
4.7	Operation of main switch - functional check (612.13.2)						✓		
4.8	Manual operation of circuit breakers and RCDs to prove disconnection (537.2.2.2)						✓		
4.9	Correct identification of circuit details and protective devices (514.8.1; 514.9.1)						✓		
4.10	Presence of RCD quarterly test notice at or near consumer unit / distribution board (514.12.2)						✓		
4.11	Presence of non-standard (mixed) cable colour warning notice at or near consumer unit / distribution board (514.14)						✓		
4.12	Presence of alternative supply warning notice at or near consumer unit / distribution board (514.15)						✓		
4.13	Presence of other required labelling (please specify) *** (Section 514)						N/A		

N. INSPECTION SCHEDULE FOR A DISTRIBUTION BOARD INSTALLATION										
Outcomes		Acceptable Condition ✓	Unacceptable condition C1 or C2	Improvement recommended C3	Further investigation: FI	Not Verified: NV	Limitation: LIM	Not Applicable: N/A		
ITEM	DESCRIPTION						OUTCOME (Use codes above. Provide additional comment where appropriate. C1, C2, C3 and FI coded items to be recorded in Section K of the Condition Report)			
4.14	Examination of protective device(s) and base(s); correct type and rating (no signs of unacceptable thermal damage, arcing or overheating) (421.1.3)						✓			
4.15	Single-pole switching or protective devices in line conductor only (132.14.1; 530.3.2)						✓			
4.16	Protection against mechanical damage where cables enter the consumer unit or distribution board (522.8.1, 522.8.11)						✓			
4.17	Protection against electromagnetic effects where cables enter consumer unit / distribution board / enclosures (521.5.1)						✓			
4.18	RCD(s) provided for fault protection – includes RCBOs (411.4.9; 411.5.2; 531.2)						✓			
4.19	RCD(s) provided for additional protection - includes RCBOs (411.3.3; 415.1)						✓			
4.20	Confirmation of indication that SPD is functional (534.2.8)						✓			
4.21	Confirmation that ALL conductor connections, including connections to busbars, are correctly located in terminals and are tight and secure (526.1)						✓			
4.22	Adequate arrangements where a generating set operates as a switched alternative to the public supply (551.6)						✓			
4.23	Adequate arrangements where a generating set operates in parallel with the public supply (551.7)						✓			
5.0	FINAL CIRCUITS									
5.1	Identification of conductors (514.3.1)						✓			
5.2	Cables correctly supported throughout their run (522.8.5)						✓			
5.3	Condition of the insulation of live parts (416.1)						✓			
5.4	Non-sheathed cables protected by enclosure in conduit, ducting or trunking (521.10.1) To include the integrity of conduit and trunking systems (metallic and plastic)						✓			
5.5	Adequacy of cables for current-carrying capacity with regard for the type and nature of installation (Section 523)						✓			
5.6	Coordination between conductors and overload protective devices (433.1; 533.2.1)						✓			
5.7	Adequacy of protective devices: type and rated current for fault protection (411.3)						✓			
5.8	Presence and adequacy of circuit protective conductors (411.3.1.1; 543.1)						✓			
5.9	Wiring system(s) appropriate for the type and nature of the installation and external influences (section 522)						✓			
5.10	Concealed cables installed in prescribed zones (see Section D. Extent and limitations) (522.6.202)						LIM			
5.11	Concealed cables incorporating earthed armour or sheath, or run within earthed wiring system, or otherwise protected against mechanical damage from nails, screws and the like (see Section D. Extent and limitations) (522.6.101; 522.6.103)						LIM			
5.12	Provision of additional protection by RCD not exceeding 30 mA									
*	For all socket outlets of a rating of 20 A or less provided for use by ordinary persons unless exempt (411.3.3)						✓			
*	Used to supply mobile equipment not exceeding 32 A rating for use outdoors (411.3.3)						✓			
*	For cables concealed in walls at a depth of less than 50 mm (522.6.202; 522.6.203)						N/A			
*	For cables concealed in walls/partitions containing metal parts regardless of depth (522.6.203)						N/A			
5.13	Provision of fire barriers, sealing arrangements and protection against thermal effects (527)						✓			
5.14	Band II cables segregated or separated from Band I cables (528.1)						✓			
5.15	Cables segregated or separated from communication cabling (528.2)						✓			
5.16	Cables segregated or separated from non-electrical services (528.3)						✓			

N. INSPECTION SCHEDULE FOR A DISTRIBUTION BOARD INSTALLATION										
Outcomes		Acceptable Condition  ✓	Unacceptable condition C1 or C2 	Improvement recommended C3 	Further investigation: FI 	Not Verified: NV	Limitation: LIM	Not Applicable: N/A		
ITEM	DESCRIPTION							OUTCOME (Use codes above. Provide additional comment where appropriate. C1, C2, C3 and FI coded items to be recorded in Section K of the Condition Report)		
5.17	Termination of cables at enclosures – indicate extent of sampling in Section D of the report (Section 526)									
*	Connections soundly made and under no undue strain (526.6)							 ✓		
*	No basic insulation of a conductor visible outside enclosure (526.8)							 ✓		
*	Connections of live conductors adequately enclosed (526.5)							 ✓		
*	Adequately connected at the point of entry to enclosure (glands, bushes etc) (522.8.5)							 ✓		
5.18	Condition of accessories including socket-outlets, switches and joint boxes (621.2 (iii))							 C3		
5.19	Suitability of accessories for external influences (512.2)							 ✓		
5.20	Adequacy of working space/accessibility to equipment (132.12; 513.1)							 ✓		
5.21	Single-pole switching or protective devices in line conductors only (132.14.1, 530.3.2)							 ✓		
6.0	LOCATION(S) CONTAINING A BATH OR SHOWER									
6.1	Additional protection for all low voltage (LV) circuits by RCD not exceeding 30 mA (701.411.3.3)							N/A		
6.2	Where used as a protective measure, requirements for SELV or PELV met (701.414.4.5)							N/A		
6.3	Shaver sockets comply with BS EN 61558-2-5 or BS 3535 (701.512.3)							N/A		
6.4	Presence of supplementary bonding conductors unless not required by BS 7671:2008 (701.415.2)							N/A		
6.5	Low voltage (e.g. 230 volt) socket-outlets sited at least 3 m from zone 1 (701.512.3)							N/A		
6.6	Suitability of equipment for external influences for installed location in terms of IP rating (701.512.2)							N/A		
6.7	Suitability of equipment for installation in a particular zone (701.512.3)							N/A		
6.8	Suitability of current-using equipment for particular position within the location (701.55)							N/A		
7.0	OTHER PART 7 SPECIAL INSTALLATIONS OR LOCATIONS									
7.1	List all other special installations or locations present, if any (*Record separately the results of particular inspections applied)							N/A		


*Special installations or locations present, if any. Details of circuits and/or installed equipment vulnerable to damage when testing and/or remarks

CONDITION REPORT GUIDANCE FOR RECIPIENTS

(to be appended to the report)

This report is an important and valuable document which should be retained for future reference

- 1 The purpose of this Condition Report is to confirm, so far as reasonably practicable, whether or not the electrical installation is in a satisfactory condition for continued service (see Section E). The Report should identify any damage, deterioration, defects and/or conditions which may give rise to danger (see Section K).
- 2 The person ordering the Report should have received the “original” Report and the inspector should have retained a duplicate.
- 3 The Report should be retained in a safe place and be made available to any person inspecting or undertaking work on the electrical installation in the future. If the property is vacated, this Report will provide the new owner/occupier with details of the condition of the electrical installation at the time the Report was issued.
- 4 Where the installation incorporates a residual current device (RCD) there should be a notice at or near the device stating that it should be tested quarterly. For safety reasons it is important that this instruction is followed.
- 5 Section D (Extent and Limitations) should identify fully the extent of the installation covered by this Report and any limitations on the inspection and testing. The inspector should have agreed these aspects with the person ordering the Report and with other interested parties (licensing authority, insurance company, mortgage provider and the like) before the inspection was carried out.
- 6 Some operational limitations such as inability to gain access to parts of the installation or an item of equipment may have been encountered during the inspection. The inspector should have noted these in Section D.
- 7 For items classified in Section K as C1 (“Danger present”), the safety of those using the installation is at risk, and it is recommended that a skilled person competent in electrical installation work undertakes the necessary remedial work immediately.
- 8 For items classified in Section K as C2 (“Potentially dangerous”), the safety of those using the installation may be at risk and it is recommended that a skilled person competent in electrical installation work undertakes the necessary remedial work as a matter of urgency.
- 9 Where it has been stated in Section K that an observation requires further investigation (code FI) the inspection has revealed an apparent deficiency which may result in a code C1 or C2, and could not, due to the extent or limitations of the inspection, be fully identified. Such observations should be investigated without delay. A further examination of the installation will be necessary, to determine the nature and extent of the apparent deficiency (see Section F).
- 10 For safety reasons, the electrical installation should be re-inspected at appropriate intervals by a skilled person or persons, competent in such work . The recommended date by which the next inspection is due is stated in Section F of the Report under ‘Recommendations’ and on a label at or near to the consumer unit/distribution board.ommended that a competent person undertakes the necessary remedial work immediately.

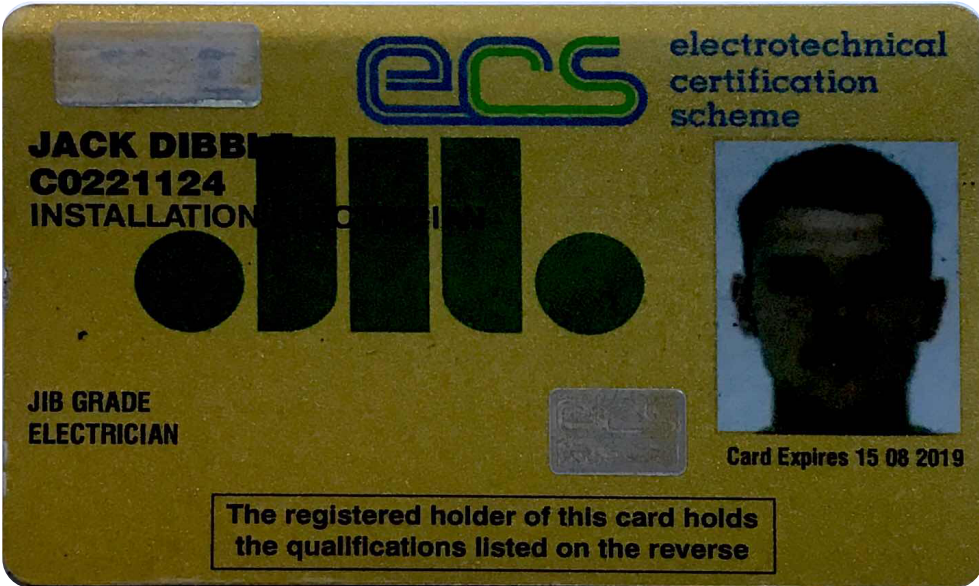

CODES FOR TYPE OF WIRING							Reference Methods are methods of installation for which the current-carrying capacity has been determined by test or calculation
A	B	C	D	E	F	G	
PVC/PVC CABLES	PVC CABLES IN METALLIC CONDUIT	PVC CABLES IN NON-METALLIC CONDUIT	PVC CABLES IN METALLIC TRUNKING	PVC CABLES IN NON-METALLIC TRUNKING	PVC/SWA CABLES	XLPE/SWA CABLES	